

## **Determination of the sound absorption in the reverberation room, method according to EN ISO 354**

---

Test object	Testseries Phon 40 mm System Classic Fine
Test lab	Reverberation room Institut für Lärmschutz Kühn & Blickle Gewerbstrasse 9b 6314 Unterägeri
Applicant	BASWA acoustic AG Marmorweg 10 6283 Baldegg

---

Created	Unterägeri, 17. June 2017
Author	Renzo Cremonini T: +41 41 459 70 91, renzo.cremonini@pirminjung.ch

---

### **PIRMIN JUNG Schweiz AG**

Grossweid 4, CH-6026 Rain, +41 41 459 70 40  
Bahnhofpark 1, CH-7320 Sargans, +41 81 254 70 40  
Frutigenstrasse 2, CH-3600 Thun, +41 33 227 72 40  
Bahnhofstrasse 86, CH-8500 Frauenfeld, +41 52 724 70 40  
info@pirminjung.ch, pirminjung.ch

## Table of contents

1	Introduction.....	3
2	General provisions.....	3
3	Description of the test specimens.....	3
4	Measurements.....	3
4.1	Measuring Instruments.....	3
4.2	- Measurement of reverberation time.....	3
4.3	Evaluation of sound absorption.....	4

## Annex

- Data sheet of the acoustic absorption measurements

## 1 Introduction

The company BASWA acoustic AG commissioned us to evaluate the sound absorption coefficient of an acoustic system.

The reverberation time measurements to evaluate the sound absorption coefficient took place on 17.06.2017 in the reverberation room of the Instituts für Lärmschutz Kühne & Blickle.

## 2 General provisions

The measurements are carried out according to the following standard:

- DIN EN ISO 354 (2003) „ Acoustics - Measurement of sound absorption in a reverberation room “

## 3 Description of the test specimens

The test specimen consist of elements which are installed in a rectangular wooden frame. The test specimen has an area of 12 m<sup>2</sup>.

The description of the specimen is listed in the following table.

Name	Aufbau	Disposition
BASWA Phon Classic Fine 40mm	12.5 mm gypsum board BASWA Fix K, 1 - 1.5 mm, Adhesive BASWA Phon acoustic panel, 36mm BASWA Fill, seamfiller	suspended 200 mm on concrete
	BASWA Base, ca. 1.5 – 2.0 mm, base layer BASWA Fine, ca. 1.5 – 2.0 mm, final layer	

## 4 Measurements

### 4.1 Measuring Instruments

The sound measurements were carried out with the following measuring instruments:

- NTi-Audio Mod. XL2 sound level meter
- M2230 measurement microphone, class 1 certification, dynamic range of 16 to 139 dB(A)
- Outline dodecahedron loudspeakers with Outline GSA GlobeAmp amplifier, four channel

### 4.2 Measurement of reverberation time

The measurements were carried out according to the instructions on the EN ISO 354 Standard. For each test specimen five microphone positions and two loudspeaker positions were considered; 15 independent decay curves were measured.

The reverberation time in the empty room is shown in the following diagram:

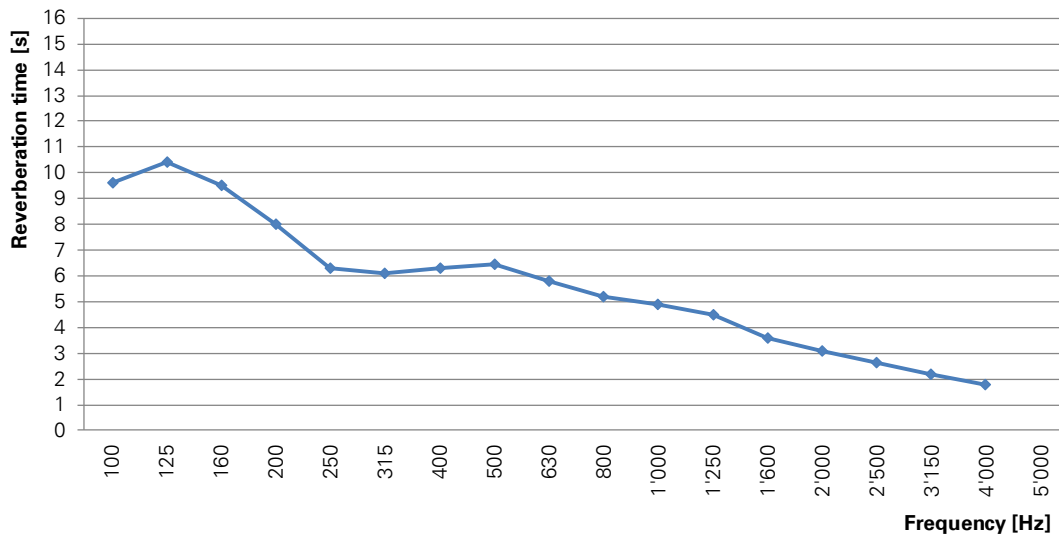


Figure 1: Reverberation time in empty room

The room temperature during the measurements has been constant by 19°C and the relative humidity has been 72 %.

#### 4.3 Evaluation of sound absorption

The sound absorption coefficient  $\alpha_s$  of the test specimen is calculated using the formula:

$$\alpha_s = \frac{55.3}{c} \cdot V \cdot \left( \frac{1}{T_2} - \frac{1}{T_1} \right)$$

where:

- V: Volume of the reverberation room (212 m<sup>3</sup>)
- S: Area of the test specimen (11.5m<sup>2</sup>)
- T<sub>1</sub>: Reverberation time of the empty reverberation room (in s)
- T<sub>2</sub>: Reverberation time of the reverberation room with the test specimen (in s)
- c: Velocity of sound in air (in m/s) : c = 343 m/s by 20°C

The Indicators (L), (M), or (H) provide additional information on the frequency response of the sound absorption at low frequencies (L), mid-frequency (M) and high frequencies (H).

PIRMIN JUNG Schweiz AG

Renzo Cremonini

# Acoustic absorption values according to ISO 354

Acoustic absorption as measured in reverberation room


Applicant: BASWA acoustic AG  
Marmorweg 10, 6283 Baldegg  
Test date: 17.06.2017  
Project: Testserie Phon 40 mm System Classic Fine  
Measurement: **Acoustic absorption**  
Test lab: Hallraum Institut für Lärmschutz Kühn & Blickle  
Gewerbstrasse 9b, 6314 Unterägeri  
Test object: **BASWA Phon Classic Fine 40mm - on concrete**

## Composition:

12.5 mm gypsum board  
BASWA Fix K, 1 - 1.5 mm, Adhesive  
BASWA Phon acoustic panel, 36mm  
BASWA Fill, seam filler  
BASWA Base, ca. 1.5 – 2.0 mm, base layer  
BASWA Fine, ca. 1.5 – 2.0 mm, final layer

Test surface [m<sup>2</sup>]: 12 m<sup>2</sup>  
Volume reverberation room [m<sup>3</sup>]: 212 m<sup>3</sup>  
Temperature [°C]: 19 °C  
Humidity [%]: 72 %

Frequency [Hz]	$\alpha_s$	$\alpha_p$
	1/3 oct	1/1 oct
100	0.37	0.30
125	0.23	
160	0.30	
200	0.59	0.75
250	0.74	
315	0.85	
400	0.84	0.85
500	0.90	
630	0.83	
800	0.84	0.85
1000	0.88	
1250	0.86	
1600	0.89	0.80
2000	0.79	
2500	0.73	
3150	0.75	0.75
4000	0.79	
5000	0.66	

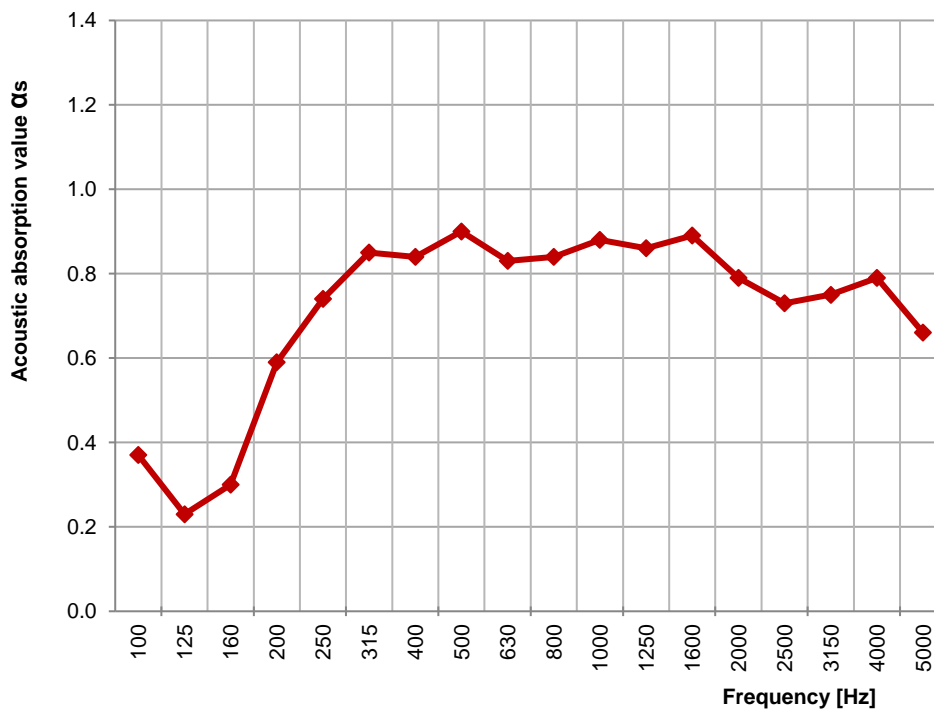

Certificate according to ISO 11654:

Acoustic absorption value  $\alpha_w = 0.85$   
Acoustic absorption class **B**

Certificate according to ASTM C423 - 09a:

Noise Reduction Coefficient **NRC = 0.85**  
Sound Absorption Average **SAA = 0.81**

PIRMIN JUNG Schweiz AG

Renzo Cremonini

Acoustic absorption as measured in reverberation room


Applicant: BASWA acoustic AG  
 Marmorweg 10, 6283 Baldegg  
 Test date: 17.06.2017  
 Project: Testserie Phon 40 mm System Classic Fine  
 Measurement: **Acoustic absorption**  
 Test lab: Hallraum Institut für Lärmschutz Kühn & Blickle  
 Gewerbestrasse 9b, 6314 Unterägeri  
 Test object: **BASWA Phon Classic Fine 40mm - suspended 200 mm**

**Composition:**

12.5 mm gypsum board  
 BASWA Fix K, 1 - 1.5 mm, Adhesive  
 BASWA Phon acoustic panel, 36mm  
 BASWA Fill, Fugenfüller / seam filler  
 BASWA Base, ca. 1.5 – 2.0 mm, base layer  
 BASWA Fine, ca. 1.5 – 2.0 mm, final layer

Test surface [m<sup>2</sup>]: 12 m<sup>2</sup>  
 Volume reverberation room [m<sup>3</sup>]: 212 m<sup>3</sup>  
 Temperature [°C]: 19 °C  
 Humidity [%]: 72 %

Frequency [Hz]	$\alpha_s$	$\alpha_p$
	1/3 oct	1/1 oct
100	0.36	0.45
125	0.45	
160	0.60	
200	0.57	0.65
250	0.57	
315	0.86	
400	0.88	0.95
500	0.92	
630	0.99	
800	0.99	0.90
1000	0.85	
1250	0.86	
1600	0.91	0.90
2000	0.83	
2500	0.97	
3150	0.91	0.80
4000	0.71	
5000	0.84	

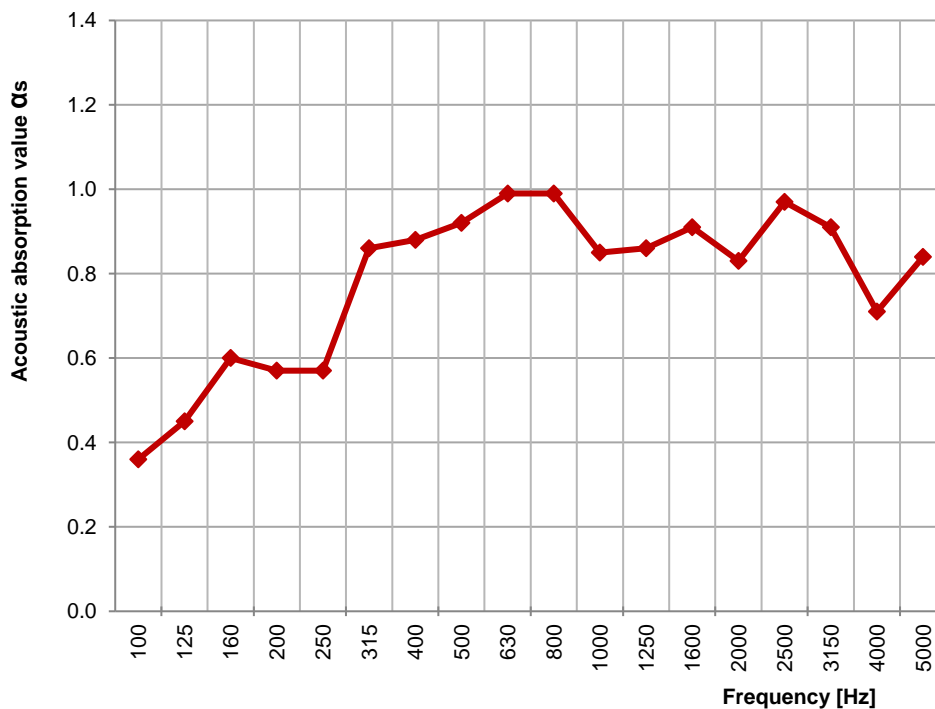

**Certificate according to ISO 11654:**

Acoustic absorption value  $\alpha_w = 0.90$   
 Acoustic absorption class **A**

**Certificate according to ASTM C423 - 09a:**

Noise Reduction Coefficient **NRC = 0.80**  
 Sound Absorption Average **SAA = 0.85**

PIRMIN JUNG Schweiz AG

Renzo Cremonini